

Tremco CPG UK Ltd

Coupland Road
Hindley Green
Wigan
Lancashire WN2 4HT

Tel: 01942 251400 Fax: 01942 251410

e-mail: hello@cpg-europe.com

website: www.cpg-europe.com



Agrément Certificate

96/3309

Product Sheet 1

TREMCO CPG UK LTD

COMPRIBAND TP600 SEALING TAPES

This Agrément Certificate Product Sheet⁽¹⁾ relates to Compriband TP600 Sealing Tapes, a range of weathertight seals for use in new or existing structural and expansion joints, in structural units of timber, plastics, masonry, metal and concrete, and as perimeter seals for openings.

(1) Hereinafter referred to as 'Certificate'.

CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.



KEY FACTORS ASSESSED

Weathertightness — the products will resist the passage of wind-driven rain, snow, run-off water and dust into the interior of the building (see section 6).

Durability — the products will have a service life of up to 20 years (see section 8).

The BBA has awarded this Certificate to the company named above for the products described herein. These products have been assessed by the BBA as being fit for their intended use provided they are installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of Fourth issue: 15 November 2022

Originally certificated on 23 December 1996

Hardy Giesler
Chief Executive Officer

The BBA is a UKAS accredited certification body – Number 113.

The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk. Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct. Any photographs are for illustrative purposes only, do not constitute advice and should not be relied upon.

British Board of Agrément

Bucknalls Lane
Watford
Herts WD25 9BA

©2022

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk

Regulations

In the opinion of the BBA, Compriband TP600 Sealing Tapes, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements of the following Building Regulations (the presence of a UK map indicates that the subject is related to the Building Regulations in the region or regions of the UK depicted):



The Building Regulations 2010 (England and Wales) (as amended)

Requirement:	C2(b)	Resistance to moisture
Comment:		The products will contribute to a wall satisfying this Requirement. See sections 6.1 to 6.3 of this Certificate.
Requirement:	7(1)	Materials and workmanship
Comment:		The products are acceptable. See section 8 and the <i>Installation</i> part of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)(2)	Fitness and durability of materials and workmanship
Comment:		The use of the products can contribute to satisfying the requirements of this Regulation. See sections 7 and 8 and the <i>Installation</i> part of this Certificate.
Regulation:	9	Building standards applicable to construction
Standard:	3.10	Precipitation
Comment:		The products will resist the effects of driving rain and contribute to the system satisfying the requirements of this Standard, with reference to clause 3.10.1 ⁽¹⁾⁽²⁾ . See sections 6.1 to 6.3 of this Certificate.
Standard:	7.1(a)	Statement of sustainability
Comment:		The products can contribute to satisfying the relevant requirements of Regulation 9, Standards 1 to 6 and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard.
Regulation:	12	Building standards applicable to conversions
Comment:		Comments in relation to the products under Regulation 9, Standards 1 to 6, also apply to this Regulation, with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾ .

(1) Technical Handbook (Domestic).
(2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2012 (as amended)

Regulation:	23(a)(i)	Fitness of materials and workmanship
Comment:	(iii)(b)(i)	The products are acceptable. See section 8 and the <i>Installation</i> part of this Certificate.
Regulation:	28(b)	Resistance to moisture and weather
Comment:		The products have adequate resistance to the ingress of rain and wind-driven spray and so can contribute towards the wall satisfying this Regulation. See sections 6.1 to 6.3 of this Certificate.

Construction (Design and Management) Regulations 2015

Construction (Design and Management) Regulations (Northern Ireland) 2016

In the opinion of the BBA, there is no information in this Certificate which relates to the obligations of the client, designer (including Principal Designer) and contractor (including Principal Contractor) under these Regulations.

NHBC Standards 2022

In the opinion of the BBA, Compriband TP600 Sealing Tapes, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements in relation to *NHBC Standards*, Chapters 6.1 *External masonry walls* and 6.9 *Curtain walling and cladding*.

Technical Specification

1 Description

1.1 Compriband TP600 Sealing Tapes are resin impregnated polyurethane weathertight seals for use in new or existing structural and expansion joints and perimeter seals around windows and doors. The tapes are available in a range of sizes.

1.2 Nominal characteristics of the tapes are given in Table 1.

Characteristic	Value
Colour	anthracite/grey
Density (kg·m ⁻³)	85-150
Cross-section	various

1.3 When fitted in a joint, the tapes re-expand to fill and seal the joint. To provide a weathertight seal the optimum final compression is 20% of the fully expanded thickness.

1.4 When on the roll, the adhesive layer is protected by a silicone release paper.

1.5 Quality control checks are carried out on the foam, the impregnating mixture and the finished products.

1.6 Dimensions of the tapes are given in Table 2.

Table 2 Tape dimensions

Tape size/code no	Suitable joint depth (mm) ⁽¹⁾	Suitable joint width (mm) ⁽²⁾
10/2	10	2
10/3	10	3
20/3	20	3
10/3-7	10	3-7
15/3-7	15	3-7
20/3-7	20	3-7
15/5-10	15	5-10
20/5-10	20	5-10
15/7-12	15	7-12
20/7-12	20	7-12
25/7-12	25	7-12
15/8-15	15	8-15
20/8-15	20	8-15
30/8-15	30	8-15
20/10-18	20	10-18
25/10-18	25	10-18
30/10-18	30	10-18
20/13-24	20	13-24
25/13-24	25	13-24
30/13-24	30	13-24
30/17-32	30	17-32
35/17-32	35	17-32
40/22-40	40	22-40

(1) Tape width (joint depth needs to be 2 - 3mm greater to allow for tape set-back).

(2) Tape thickness (joint width).

2 Manufacture

2.1 The tapes are manufactured from soft polyurethane foam impregnated with a flame-retardant synthetic resin.

2.2 As part of the assessment and ongoing surveillance of product quality, the BBA has:

- agreed with the manufacturer the quality control procedures and product testing to be undertaken
- assessed and agreed the quality control operated over batches of incoming materials
- monitored the production process and verified that it is in accordance with the documented process
- evaluated the process for management of nonconformities
- checked that equipment has been properly tested and calibrated
- undertaken to carry out the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

2.3 The management systems of Tremco CPG Germany GmbH has been assessed and registered as meeting the requirements of BS EN ISO 9001 : 2015 by TÜV Rheinland Industrie Service GmbH (Certificate 01 100 4301).

3 Delivery and site handling

3.1 The tapes are supplied pre-compressed, wound into rolls and secured by a leader tape.

3.2 The tapes are delivered in cartons (the contents vary according to size of tapes) bearing the manufacturer's name and size of tapes.

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on Compriband TP600 Sealing Tapes.

4 Use

4.1 Compriband 600 Sealing Tapes are satisfactory for use to provide a weathertight seal to structural and expansion joints, in perimeter seals around windows and doors and in new or existing joints in structural units of timber, plastics, masonry, metal or concrete.

4.2 Where particularly wide joints are to be sealed, two or more tapes may be superimposed to achieve the final overall compression of between 20 and 33% of the fully expanded dimension (typical tape sizes for various joint widths are given in Table 2). Consult the manufacturer's technical department for guidance.

4.3 Examples of indicative joint designs are shown in Figures 1 to 5.

Figure 1 Walls – pre-cast concrete panels

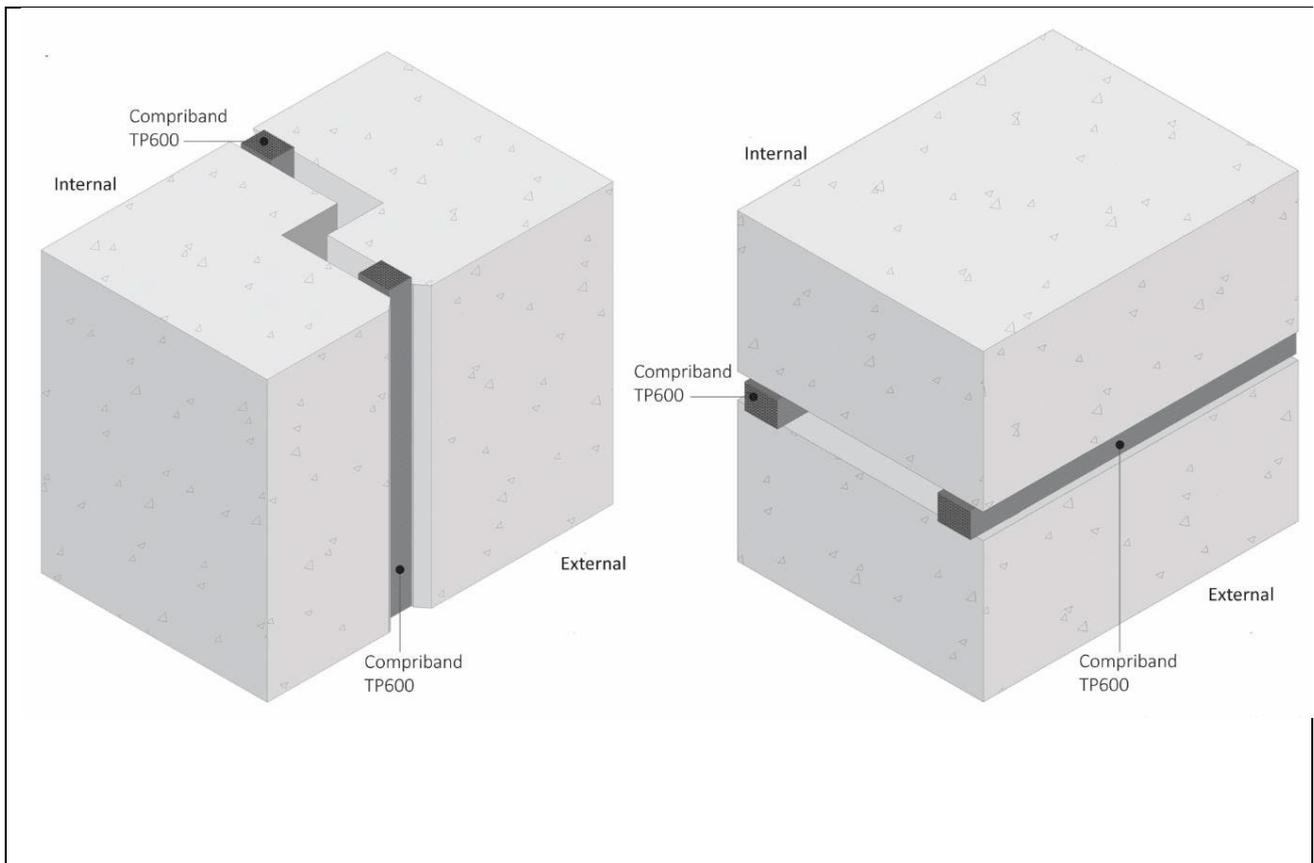


Figure 2 Walls — head, sill, jamb

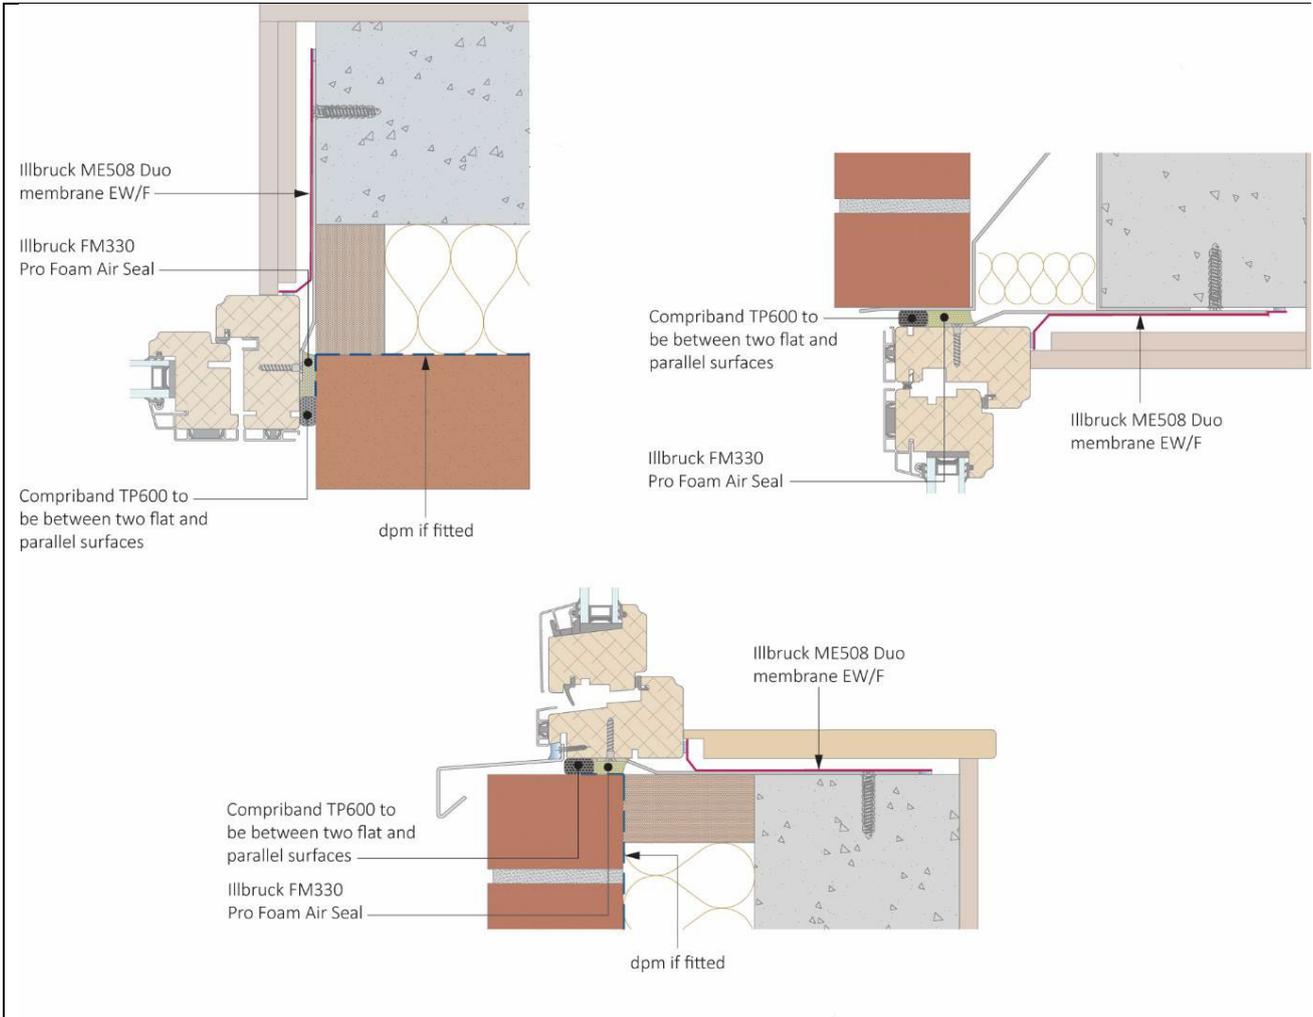


Figure 3 Windows and doors – head, sill, jamb

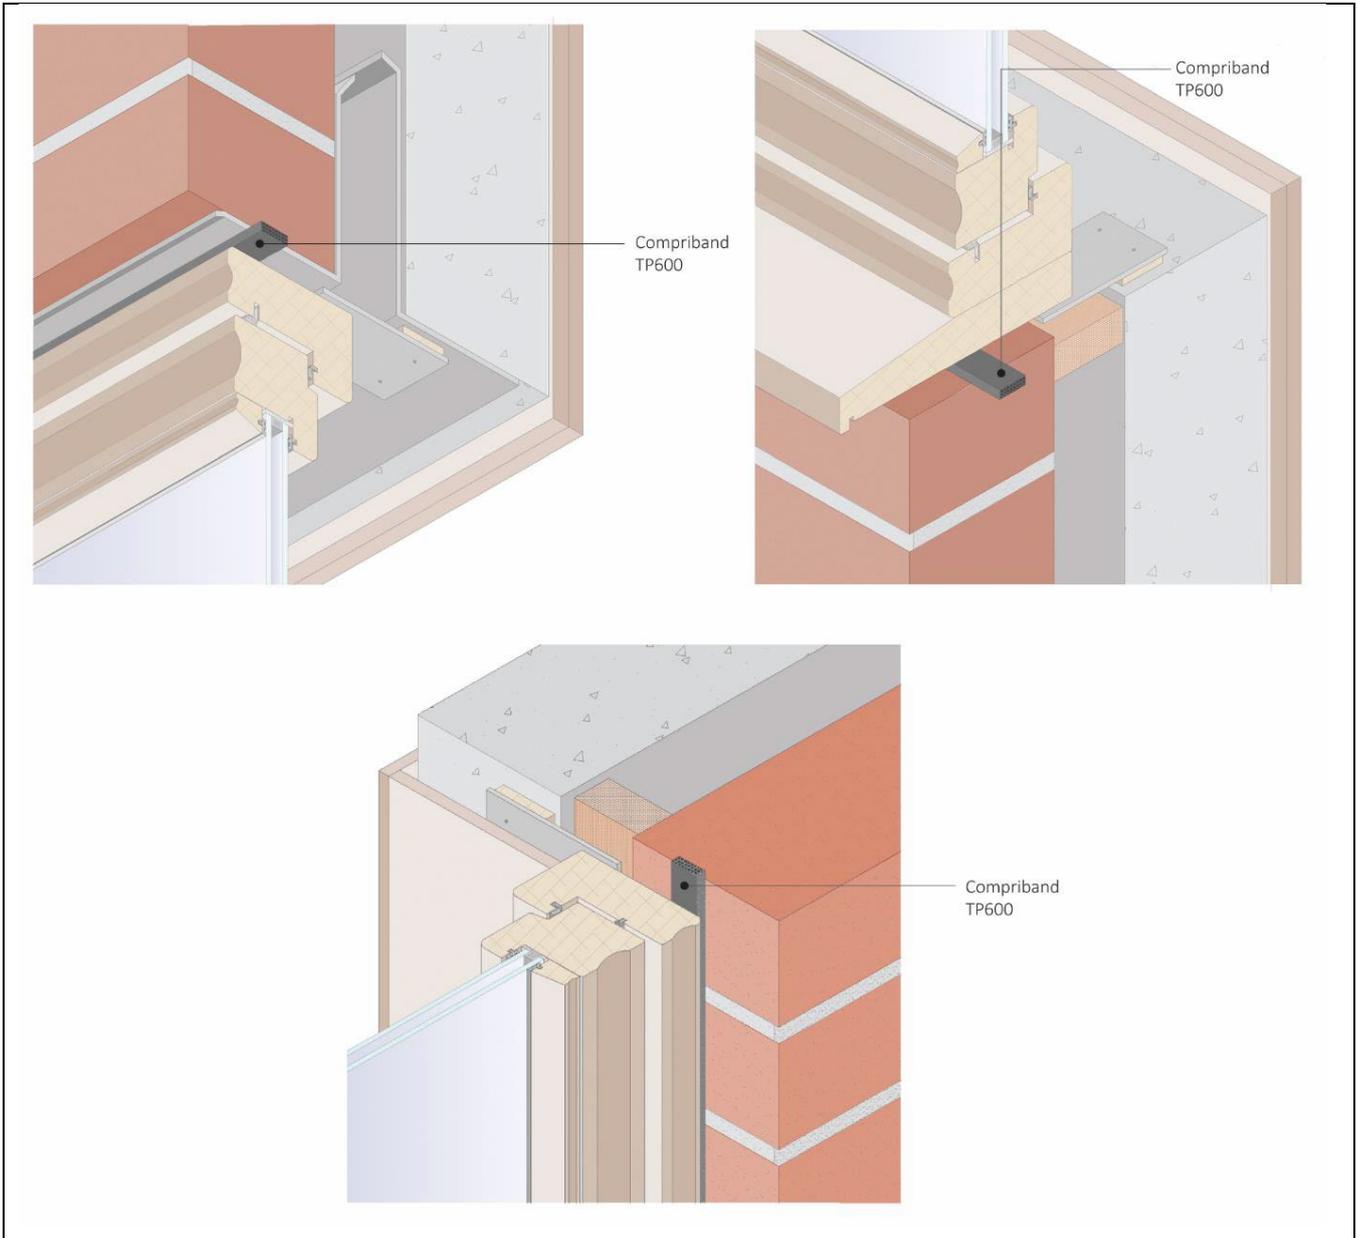


Figure 4 Timber frame walls


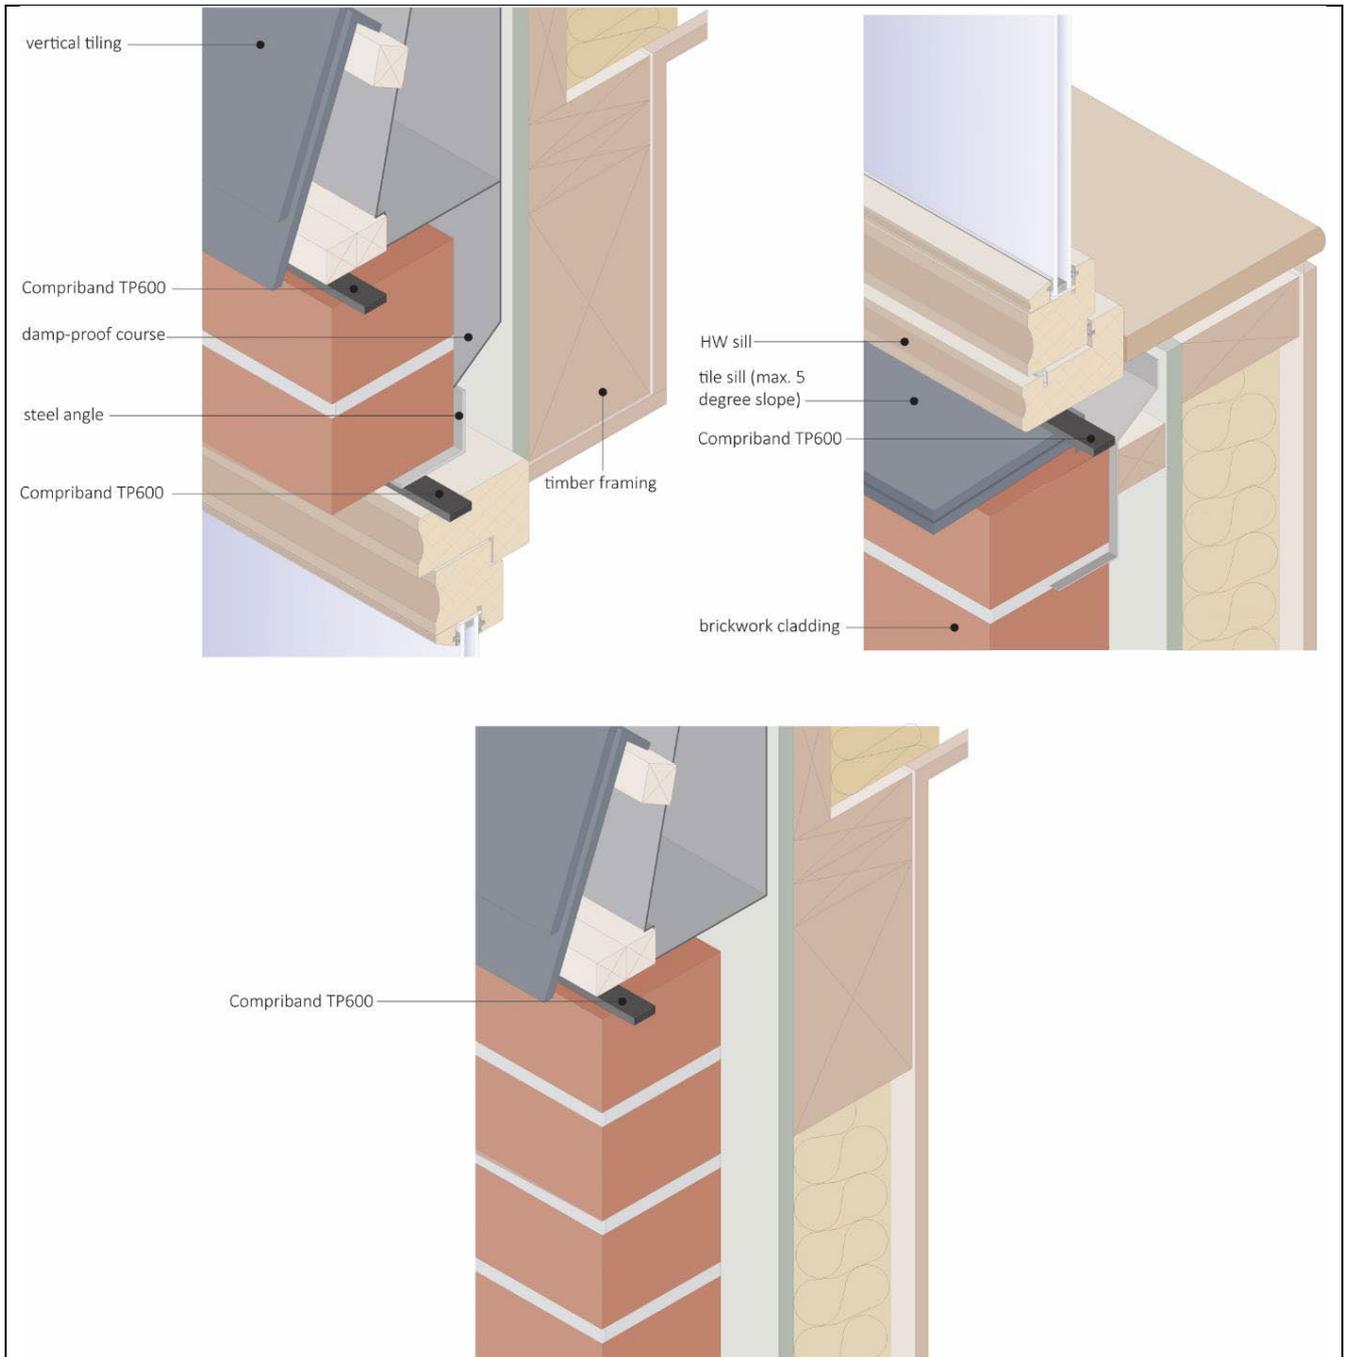


Figure 5 External sheet cladding

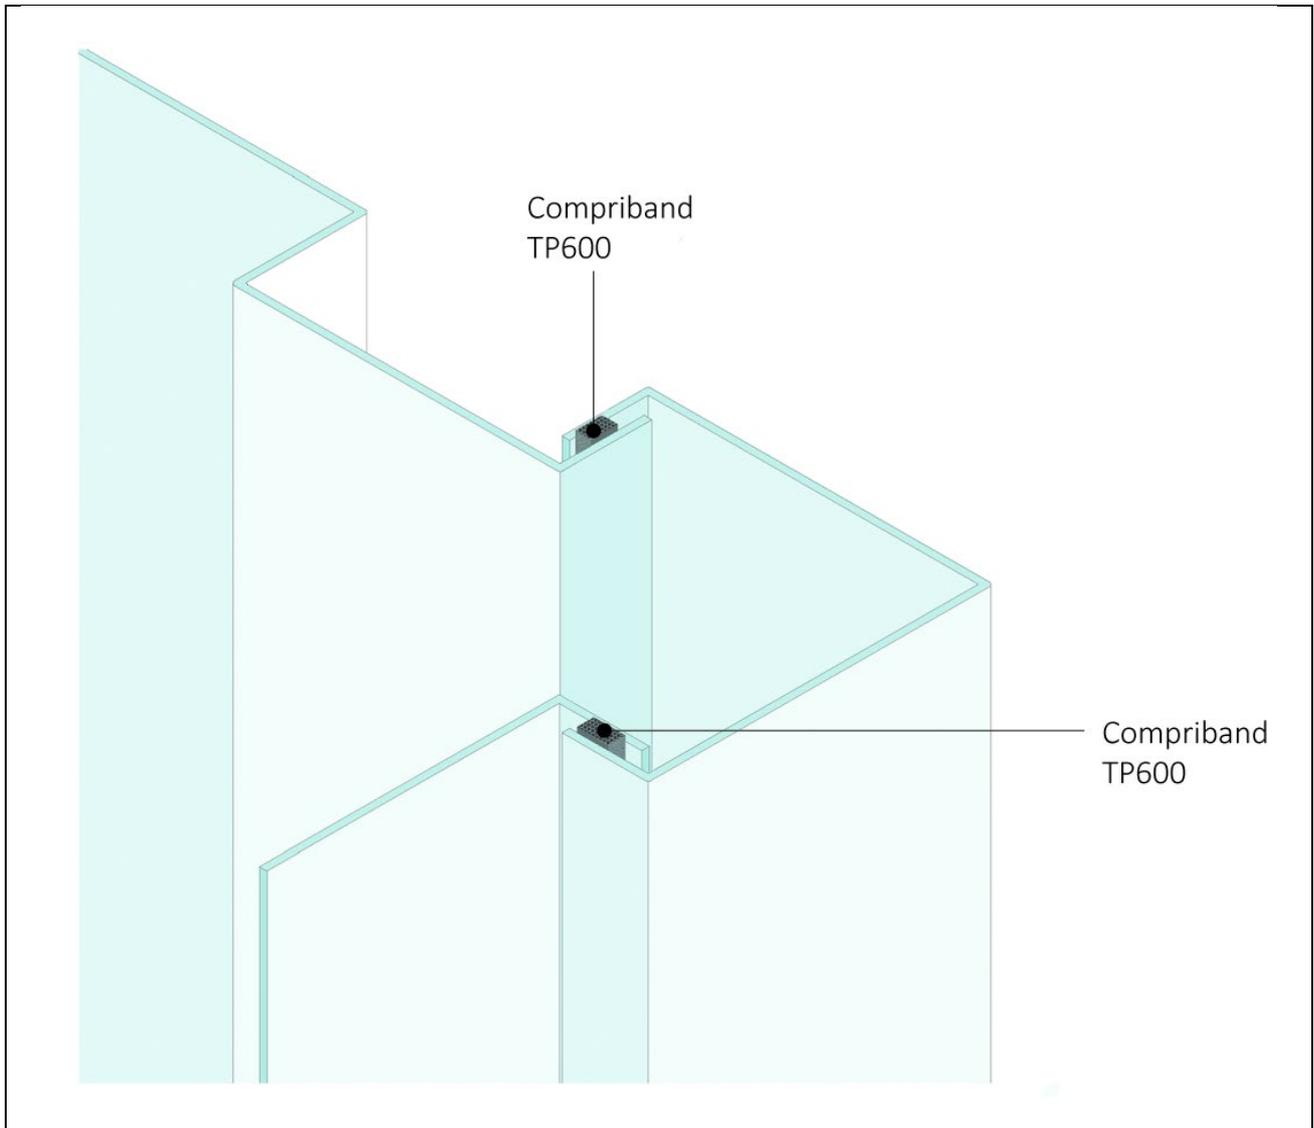

5 Practicability of installation

The products are designed to be installed by a competent general builder or contractor experienced with these types of products. It is recommended that wherever possible, site training of operatives by the manufacturer is undertaken.

6 Weathertightness



6.1 To achieve optimum resistance to water penetration, the tapes should be used under 80% compression. The tapes have a satisfactory weathertightness if used at 63% compression.

6.2 The products will resist the passage of water, wind-driven rain and dust into the interior of a building.

6.3 A sample of the products was tested in accordance with EN 1027 : 2000; no detectable water or moisture penetration occurred up to a pressure of 600 Pa. The products can therefore satisfy the Class 9A requirements of BS EN 12208 : 2000.

6.4 The tapes are not designed to withstand a head of water; in these situations the advice of the Certificate holder should be sought.

7 Maintenance



Installations should be periodically inspected for damage. Damaged sections of tape must be replaced as soon as possible.

8 Durability



Under normal service conditions, the products will have a service life of up to 20 years.

Installation

9 General

9.1 Installation must be carried out in accordance with the Certificate holder's instructions. Compriband TP600 Sealing Tapes may be installed in all conditions likely to occur in practice; however, care should be taken when used at lower ambient temperatures (see section 9.3).

9.2 Joints must be clean and free from debris, eg dirt or mortar residue likely to obstruct adhesion. The inner surfaces of the joints to be filled should be as smooth as possible. To achieve a perfect seal in masonry, the changes in level at mortar joints must be as small as possible.

9.3 The tape will start to re-expand as soon as it is unwound from the roll. The rate of re-expansion is temperature dependent and at low ambient temperatures the rate can be increased by the gentle application of heat. At high temperatures, the tapes should be stored in a cool environment prior to use (see Table 3).

Table 3 Approximate times to expand to fill a joint using 20/3-7 tape

Temperature (°C)	Re-expansion times ⁽¹⁾⁽²⁾
5	24 hours
23	10–120 mins

(1) At temperatures below 0°C re-expansion will be slow.

(2) Dependent on age of tape at the time of use.

10 Practices


10.1 The dimensions of the joint to be filled govern the size of tape used, but the width of the tape must not be less than the joint width. For particularly wide joints, two or more tapes may be superimposed. Consult the manufacturer's technical department for guidance.

10.2 When using the tapes to seal between prefabricated units during construction, the seal must be bonded to the unit already in position. The adjoining unit can then be fitted.

10.3 Joints should be designed and the tapes positioned to ensure that differential movement between panels does not tend to force the product out of the joint.

10.4 The length of the joint to be sealed must be measured and an overlap of 20 mm per metre run allowed when the tape is cut to the required length. The silicone release paper must be removed and the tape positioned in the joint, starting at the end and aligned with a flat bladed tool and set back 2 – 3 mm from the front face of the joint (see Figure 6).

Figure 6 Installation practices

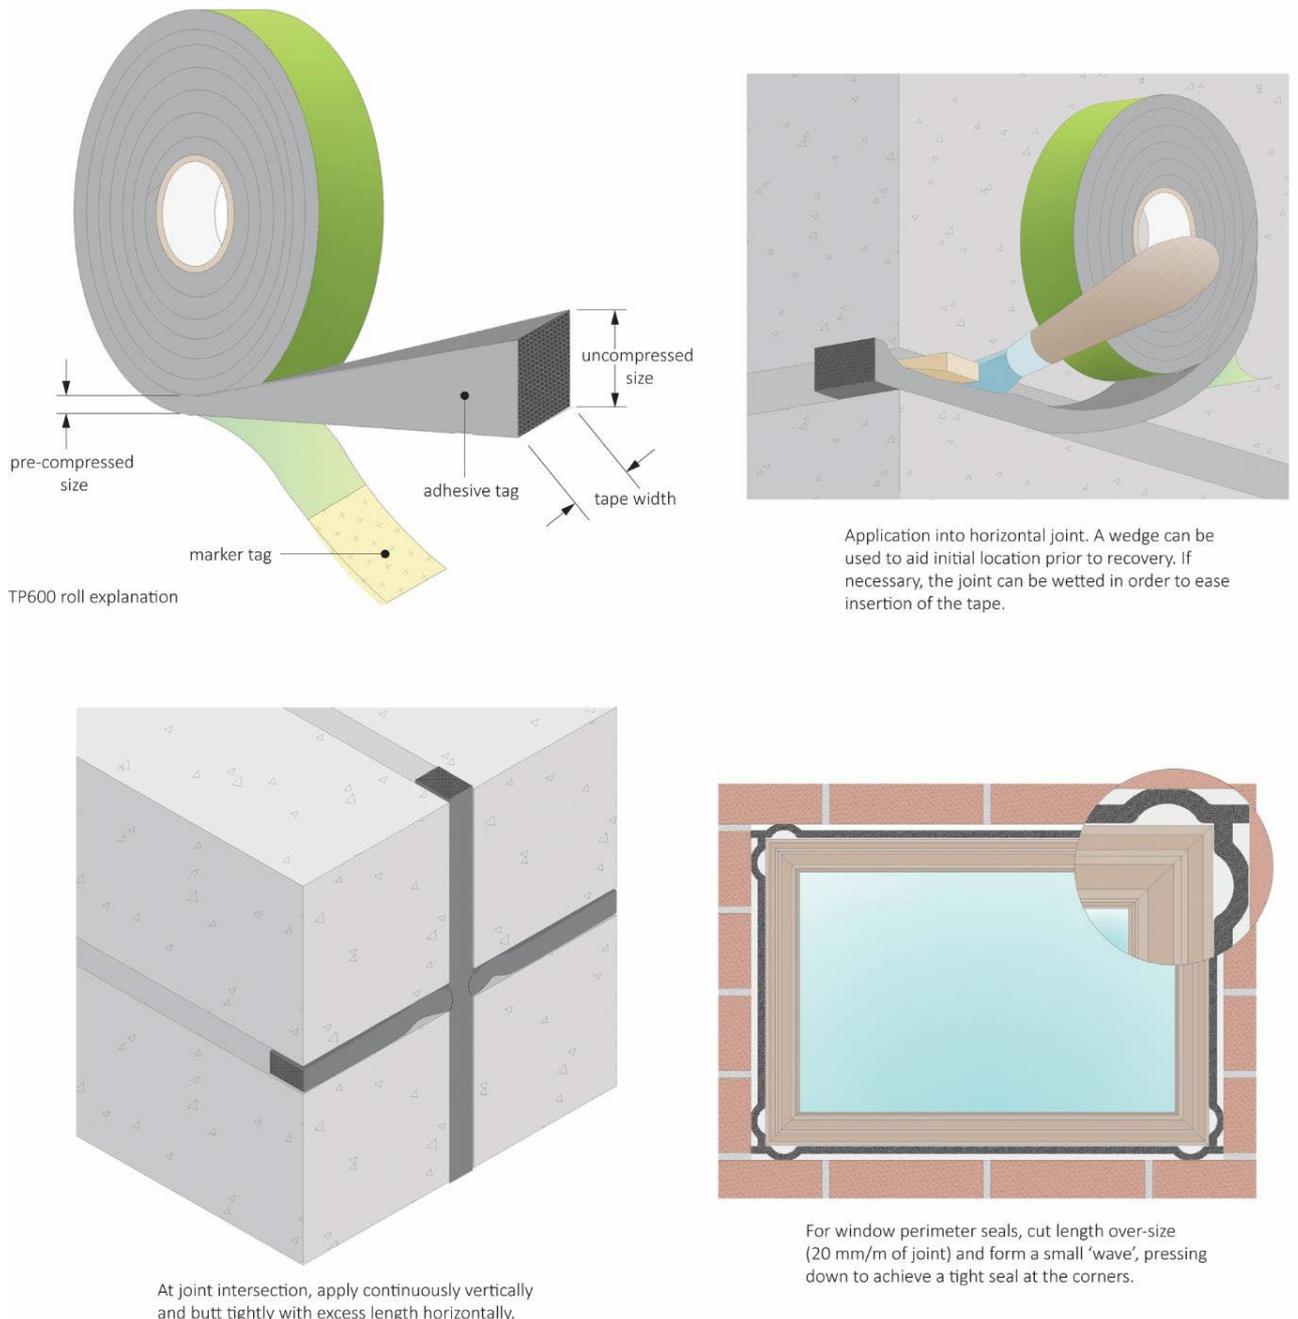

Technical Investigations

11 Tests

11.1 Tests were undertaken on samples of the tapes and the results assessed to determine:

- density of foam
- density of foam with impregnate
- percentage of impregnated material
- tensile strength
- elongation at break
- compatibility with building materials
- cold bend ability
- compression deflection
- resistance to driving rain (water leakage)

- resistance to root penetration
- resistance to oil and water-based wood preservatives
- resistance to fungal attack
- resistance to alkali
- resistance to heat ageing
- resistance to artificial weathering
- resistance to freeze/thaw cycling
- resistance to fatigue cycling
- resistance to air permeability
- weathertightness.

11.2 Samples taken from existing sites 10 years after installation were evaluated and subjected to many of the tests listed in section 11.1. The samples were found to have properties comparable to those of the new material.

12 Investigations

12.1 The manufacturing process was evaluated, including the methods adopted for quality control, and details were obtained of the quality and composition of the materials used.

12.2 A user survey was conducted to establish the products' performance in the UK.

Bibliography

BS EN 12208 : 2000 *Windows and doors – Watertightness – Classification*

BS EN ISO 9001 : 20015 *Quality management systems – Requirements*

EN 1027 : 2000 *Windows and doors – Watertightness – Test Method*

13 Conditions

13.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page – no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document – it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

13.2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

13.3 This Certificate will remain valid for an unlimited period provided that the product/system and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

13.4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

13.5 In issuing this Certificate the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- actual installations of the product/system, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product/system is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product/system, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to CE marking.

13.6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.